
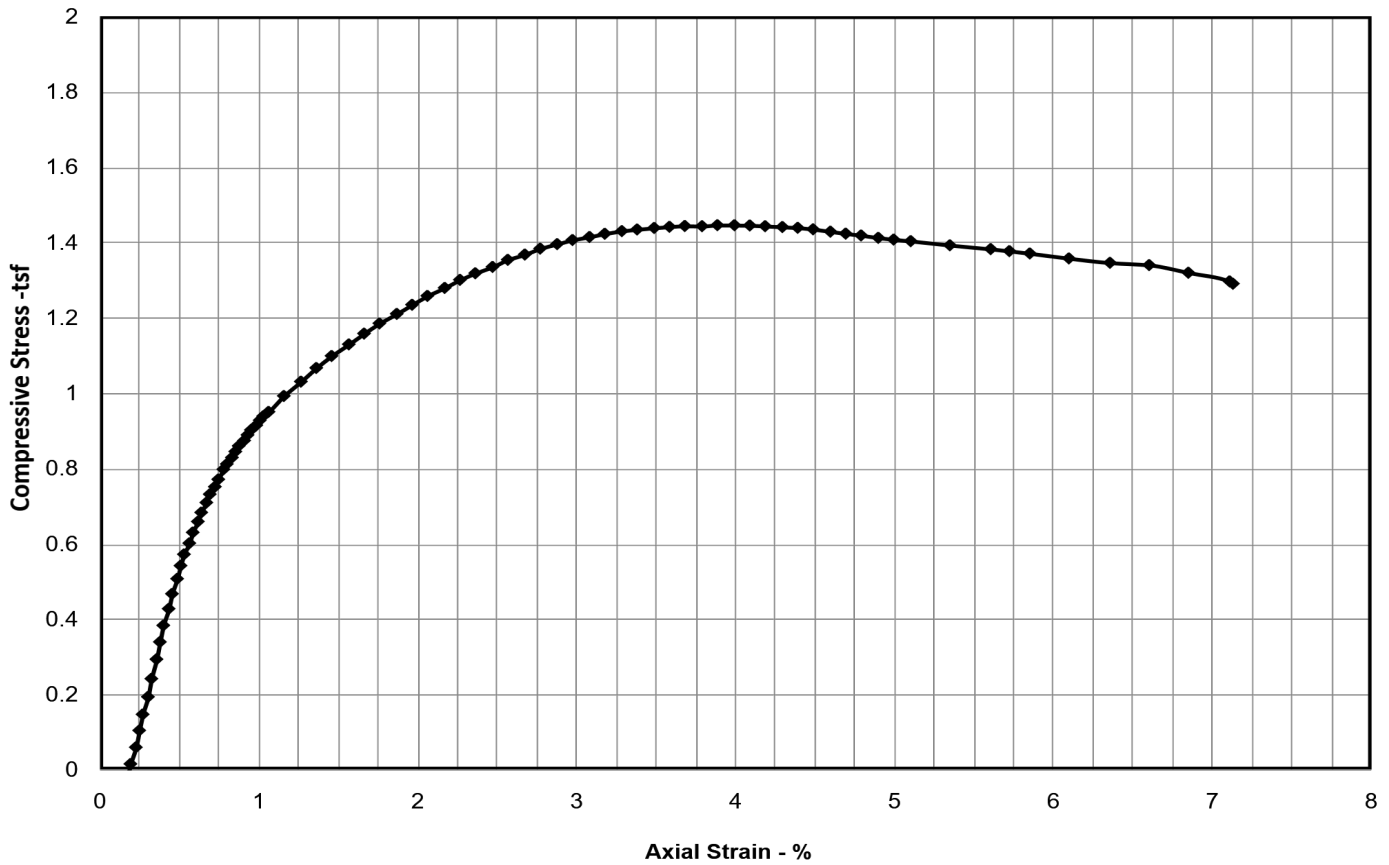


Unconsolidated Undrained Test ASTM D2850

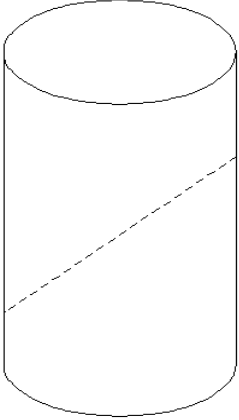

Specimen Failure Image	Specimen Test Data	
	Moisture Content (%)	41.36
	Dry Density (pcf)	86.78
	Diameter (in)	2.78
	Height (in)	5.57
	Height / Diameter Ratio	2
	Calculated Saturation (%)	118.49
	Calculated Void Ratio	0.94
	Assumed Specific Gravity	2.7
	Failure Strain (%)	3.87
	Unconfined Compressive Strength (tsf)	1.45
	Undrained Shear Strength (tsf)	0.73
	Strain Rate in/s	0.06
	Cell Pressure	50.03
Failure Mode	shear	

Boring ID	Depth (Ft)	Sample Type	Remarks:
B-03	23.5 - 25.0	SPT	

USCS Description	LL	PL	PI	Fines (%)

PROJECT: EQUIS Geotech Demo SITE: 123 Discovery Road Seattle, WA	 125 S. Alcaniz St. Pensacola FL	PROJECT NUMBER: EQUISGEOTECH CLIENT: EarthSoft
--	--	---